

ADDENDUM NO. 11 TO THE BID DOCUMENTS

Bid Number: 2020-17-81
Utility Facility Improvements Project
Addendum Date: August 7, 2020

TO: Prospective Bidders

This Addendum forms a part of the Contract Documents for the above-mentioned project. It clarifies and modifies the original Bidding Documents, where applicable. Acknowledge receipt of this Addendum in the space provided on the Bid Form and by signing this document. Failure to do so may subject Bidder to disqualification.

MISCELLANEOUS

*****Reminder*****

1. Bid Due date moved:

Sealed bids due August 14, 2020 at 2:00PM.

Sealed bids to:

Development Services Department
Attn: Tamara Gast
914 S Main Street, Suite G (PLEASE KNOCK ON DOOR)
Copperas Cove, TX 76522

BID OPENING TO BE August 14, 2020 @ 2:15PM AT THE TECHNOLOGY CENTER, 508 S 2ND STREET, COPPERAS COVE, TX 76522

PLANS

1. N/A

SPECIFICATIONS

2. N/A

ATTACHMENTS

3. See attached Question and Answer.

Acknowledgment: _____ **Date** _____

QUESTION:

Just a clarification on verbiage, on addendum 1 exhibit A. Those are all owner furnished and installed ?

ANSWER:


Yes; however, Contractor to provide electrical work, conduit, duct, OSP Copper, Fiber, CCTV where/if needed. Please see Exhibit A in Addendum No. 1.

----Please see sketch next page----

Installation shall be w/ open ceiling

- ~~Outside Camera~~
- ~~Inside Camera~~
- Network Panel

Where glass back sensors?

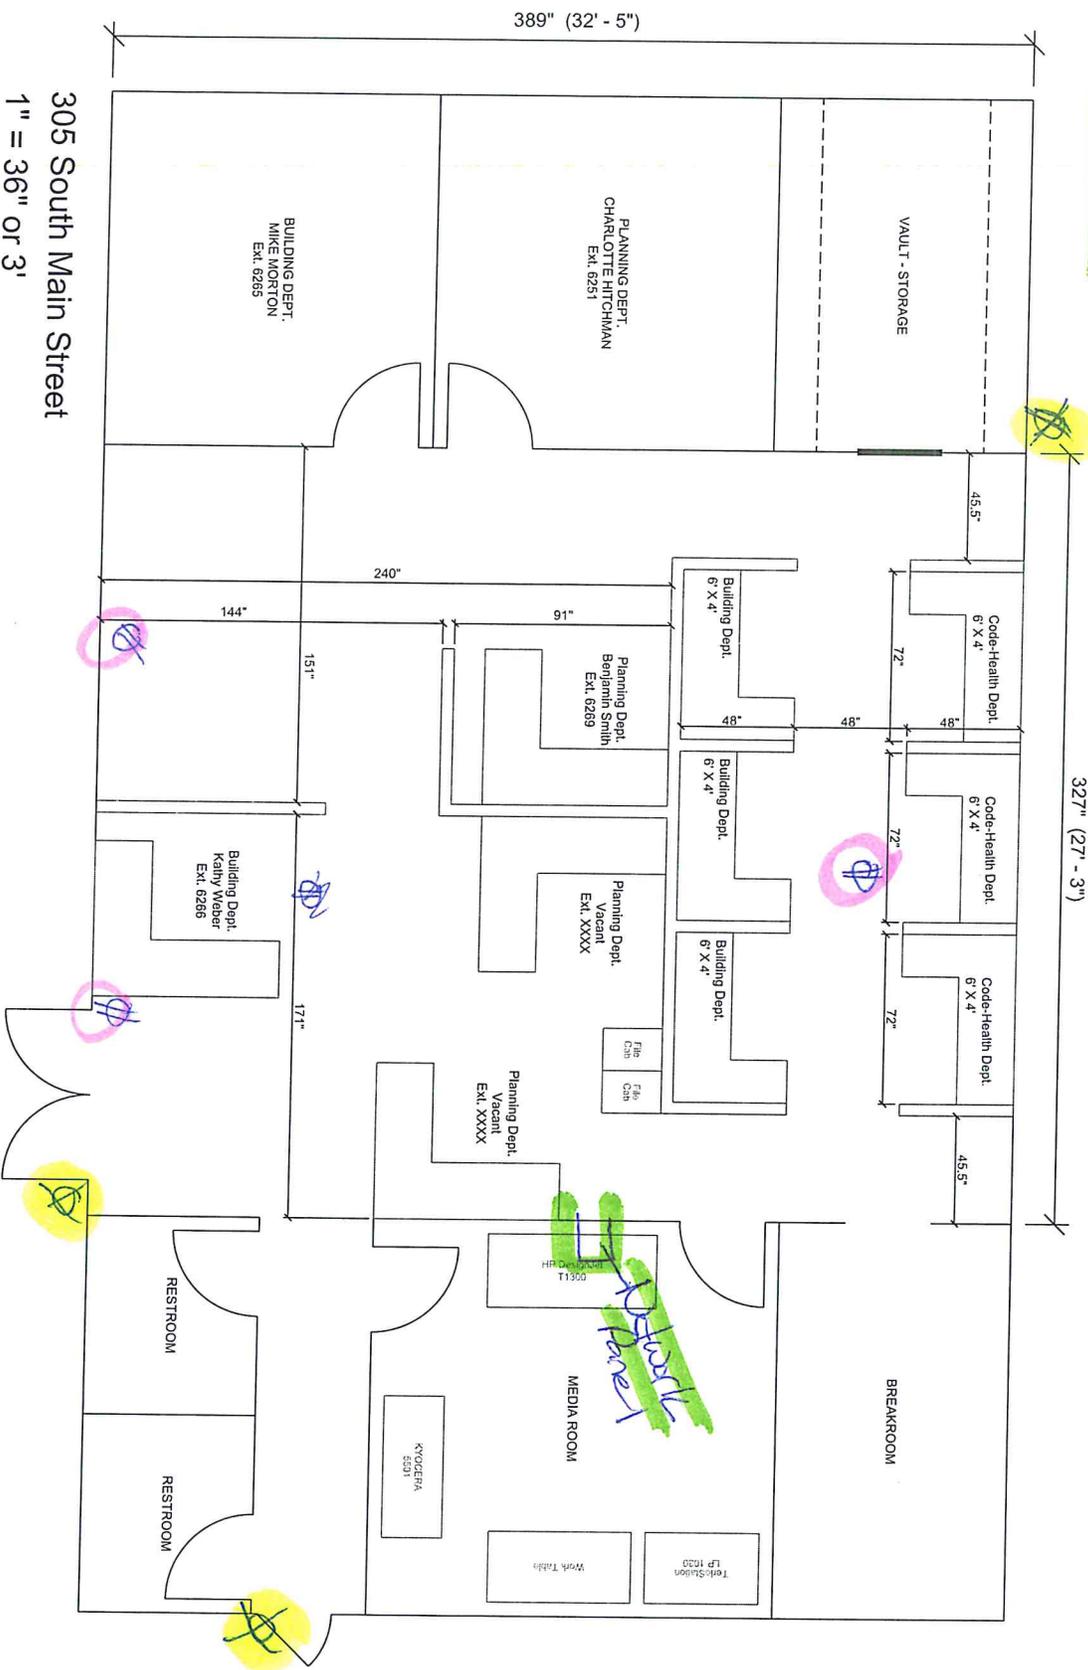

- Demolish Fiber to be picked up; Secure & don't cut or damage
- CATS cable can be yanked out - removed